FILED
08/20/2026
Executive Secretary G.P.S.C.

Docket # 31536
Document #

DIVERSE POWER INC.

OVERHEAD AND UNDERGROUND SERVICES

1. TEMPORARY OVERHEAD
2. TEMPORARY UNDERGROUND
3. 200 AMP OVERHEAD
4. 200 AMP UNDERGROUND
5. 320 AMP OVERHEAD
6. 320 AMP UNDERGROUND
7. 400 AMP OVERHEAD
8. 400 AMP UNDERGROUND

Job Name TYP. OVERHEAD TEMPORARY POLE DWG.


Customer DIVERSE POWER MEMBER

Date AUGUST 4, 2026 Sheet 1 of 1


1400 S. Davis RD.
LaGRANGE, GEORGIA
30241– 6112

PHONE #
706–845–2000
1–800–845–8362

DIVERSE POWER

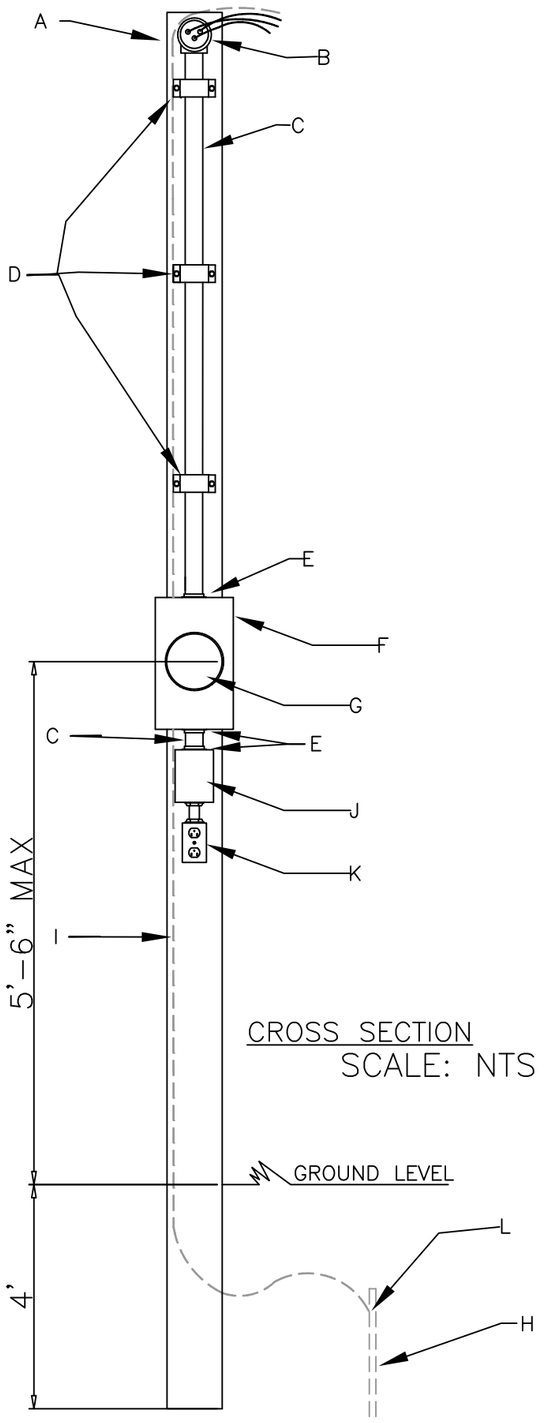

CROSS SECTION
SCALE: NTS

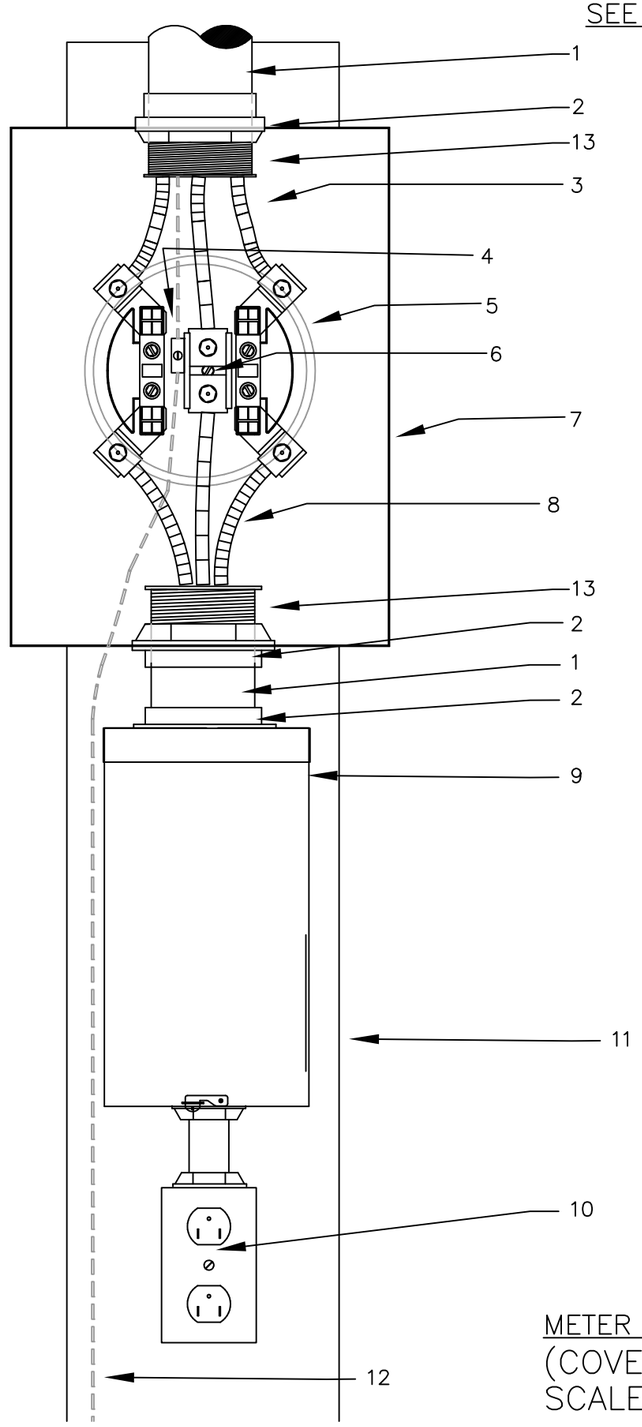

METER BASE DETAIL
(COVER NOT SHOWN)
SCALE: NTS

SEE ALL NOTES BEFORE CONSTRUCTION

NOTE :

1. 15' Min point of attachment
16'Min ground clearance required over driveways, alleys, roads, and construction areas; or any other area where truck traffic is expected.

2. Meter Base must be eye level to final grade.

3. Ground wire should be stapled to pole.

4. Meter Pole installation must be weatherproof.

5. Pole must be set 4' in ground.

6. Check with local building inspector. Some counties may require inspection before power can be connected.

7. 18" min lead on wires (2 hot wires, 1 neutral wire, and 1 ground wire).

8. Bracing: Secure two 2" × 4" wooden braces to the pole at least 9' above the ground, anchoring them outward with 2" × 4" wooden stakes. One brace should pull directly against the tension of the utility service drop, and the other should be offset by 90°.

ITEM #		METER BASE DETAIL
1		2" RIDGE PVC OR EQUIVALENT
2		2" HUB
3		4/0 TYP. WIRE SIZE
4		GROUND LUG
5		METER OUTLINE (FOR REFERENCE)
6		NEUTRAL LUG
7		METER BASE – UL APPROVED
8		ENTRANCE CABLESIZE IS DETERMINDED BY SIZE OF SERVICE. SEE COUNTY CODES/REQUIRMENTS BEFORE INSTALLING.
9		WATERPROOF DISCONNECT SWITCH
10		110 VOLT WATERPROOF OUTLET (GFI)
11		20' PRESSURE TREATED POST WITH 6" MIN DIAMETER (POST SIZE IS THE MIN. ALLOWED)
12		#6 BARE COOPER WIRE (UP TO AND INCLUDING 150 AMP. SERVICE, ANYTHING LARGER REQUIRES #4 BARE COOPER WIRE)
13		PLASTIC BUSHING

ITEM	#	CROSS SECTION MATERIAL
A		20' PRESSURE TREATED POST WITH 6" MIN DIAMETER (POST SIZE IS THE MIN. ALLOWED)
B		2" WEATHER HEAD
C		2" RIDGE PVC CONDUIT OR EQUIVALENT
D		2" 2 HOLE PIPE STRAPS
E		2" HUB
F		METER BASE – UL APPROVED
G		200 AMP METER – (SUPPLIED BY DPI)
H		8' GROUND ROD
I		#6 BARE COPPER WIRE (UP TO AND INCLUDING 150 AMP SERVICES, #4 BARE COOPER WIRE IS REQUIRED FOR ANY LARGER SERVICE.)
J		WATERPROOF DISCONNECT SWITCH
K		110 VOLT WATERPROOF OUTLET (GFI)
L		GROUND ROD CLAMP

Job Name TYP. UNDERGROUND TEMPORARY POLE DWG.


Customer DPI MEMBER

Date AUGUST 4, 2026 Sheet 1 of 1


1400 S. Davis RD.
LaGRANGE, GEORGIA
30241- 6112

PHONE #
706-845-2000
1-800-845-8362

DIVERSE POWER

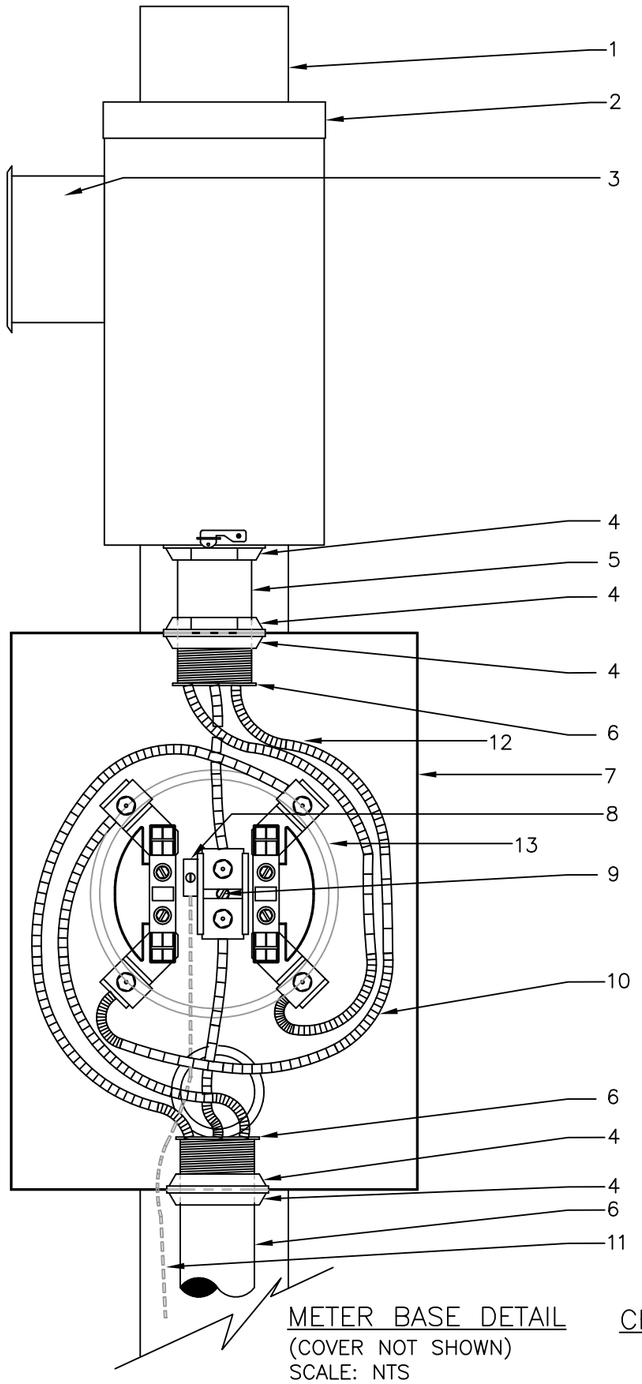

METER BASE DETAIL
(COVER NOT SHOWN)
SCALE: NTS

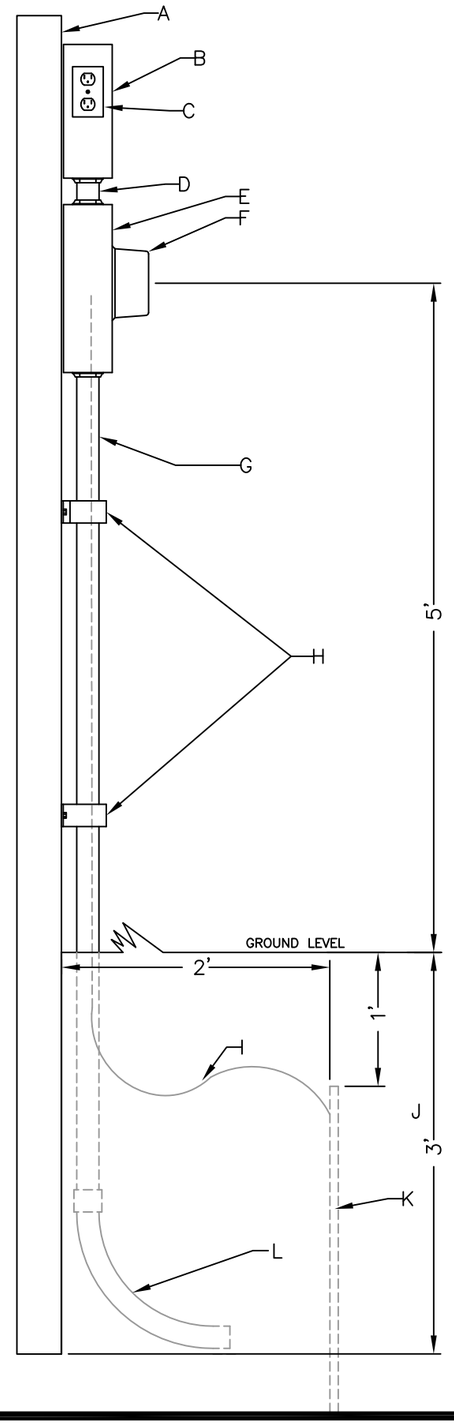

CROSS SECTION
SCALE: NTS

SEE ALL NOTES BEFORE CONSTRUCTION

NOTE :

1. A single 10' piece of conduit may be used only bymaking a 45° bend at ground level.

2. Some local codes may require outside disconnects and/or inspection before power is connected.

3. Meter base must be mounted to specs.

4. All wires must be wire brushed prior to connection to meter base.

ITEM #		METER BASE DETAIL
1		4"x4"x10' PRESSURE TREATED POST (POST SIZE IS THE MIN. ALLOWED)
2		WATERPROOF DISCONNECT SWITCH
3		110 VOLT WATERPROOF OUTLET (GFI)
4		CONDUIT LOCKNUTS
5		2" RIDGE PVC NEMA TC-4 SCH 40
6		PLASTIC BUSHING
7		METER BASE - UL APPROVED
8		GROUND LUG
9		NEUTRAL LUG
10		4/0 TYP. WIRE SIZE
11		#6 BARE COOPER WIRE (UP TO AND INCLUDING 150 AMP. SERVICE, ANYTHING LARGER REQUIRES #4 BARE COOPER WIRE)
12		ENTRANCE CABLESIZE IS DETERMINDED BY SIZE OF SERVICE. SEE COUNTY CODES/REQUIRMENTS BEFORE INSTALLING.
13		METER OUTLINE (FOR REFERENCE)

ITEM	#	CROSS SECTION MATERIAL
A		4"x4"x10' PRESSURE TREATED POST (POST SIZE IS THE MIN. ALLOWED)
B		WATERPROOF DISCONNECT SWITCH
C		110 VOLT WATERPROOF OUTLET (GFI)
D		2" RIDGE PVC CONDUIT SCH 40 NEMA TC-2 (SUPPLIED BY CONTRACTOR)
E		METER BASE - UL APPROVED
F		200 AMP METER - SUPPLIED BY DPI
G		2" RIDGE PVC NEMA TC-2 CONDUIT
H		2" 2 HOLE PIPE STRAPS
I		#6 BARE COPPER WIRE (UP TO AND INCLUDING 150 AMP SERVICES, #4 BARE COOPER WIRE IS REQUIRED FOR ANY LARGER SERVICE.)
J		GROUND ROD CLAMP
K		8' GROUND ROD
L		2" SWEEPING ELBOW

JOB NAME 200 AMP OVERHEAD METER BASE

CUSTOMER ANY EXISTING OR APPLYING DPI MEMBER

DATE AUGUST 4, 2026


SHEET 1 OF 1

1400 S. Davis RD.
LaGRANGE, GEORGIA
30241– 6112


PHONE #
706–845–2000
1–800–845–8362

DIVERSE POWER

TYPICAL ONLY

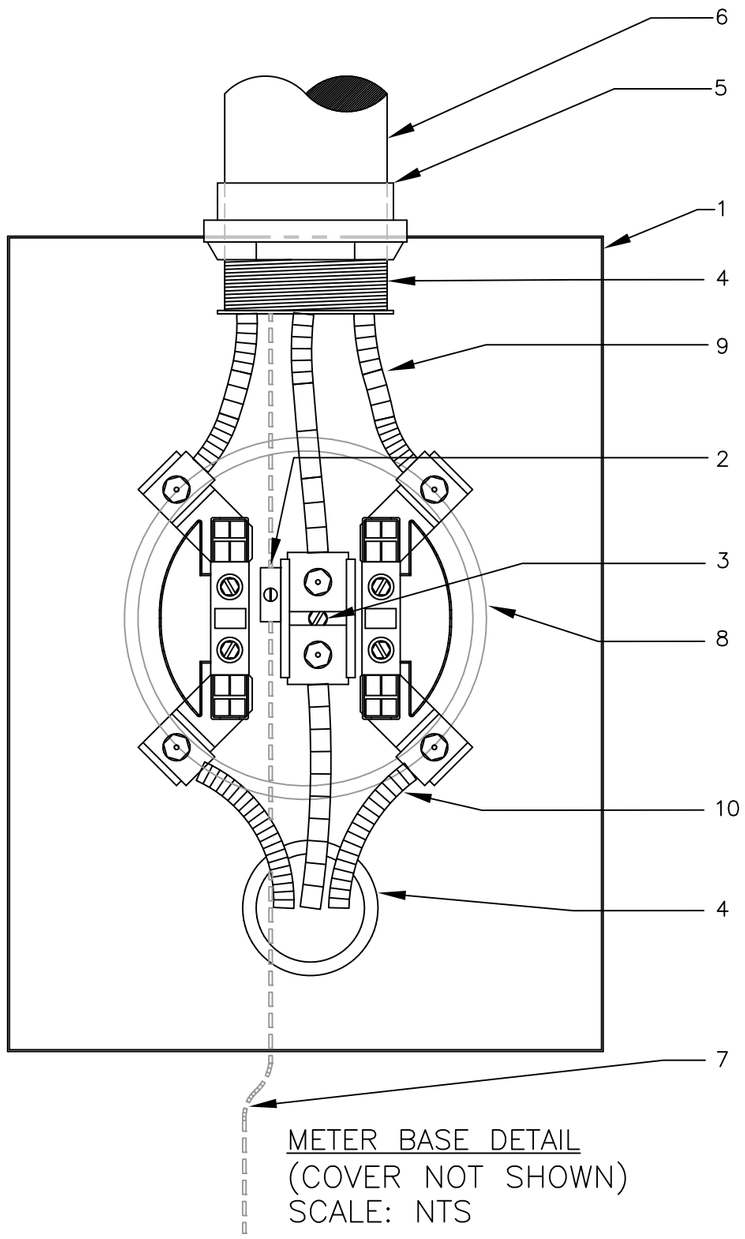

METER BASE DETAIL
(COVER NOT SHOWN)
SCALE: NTS

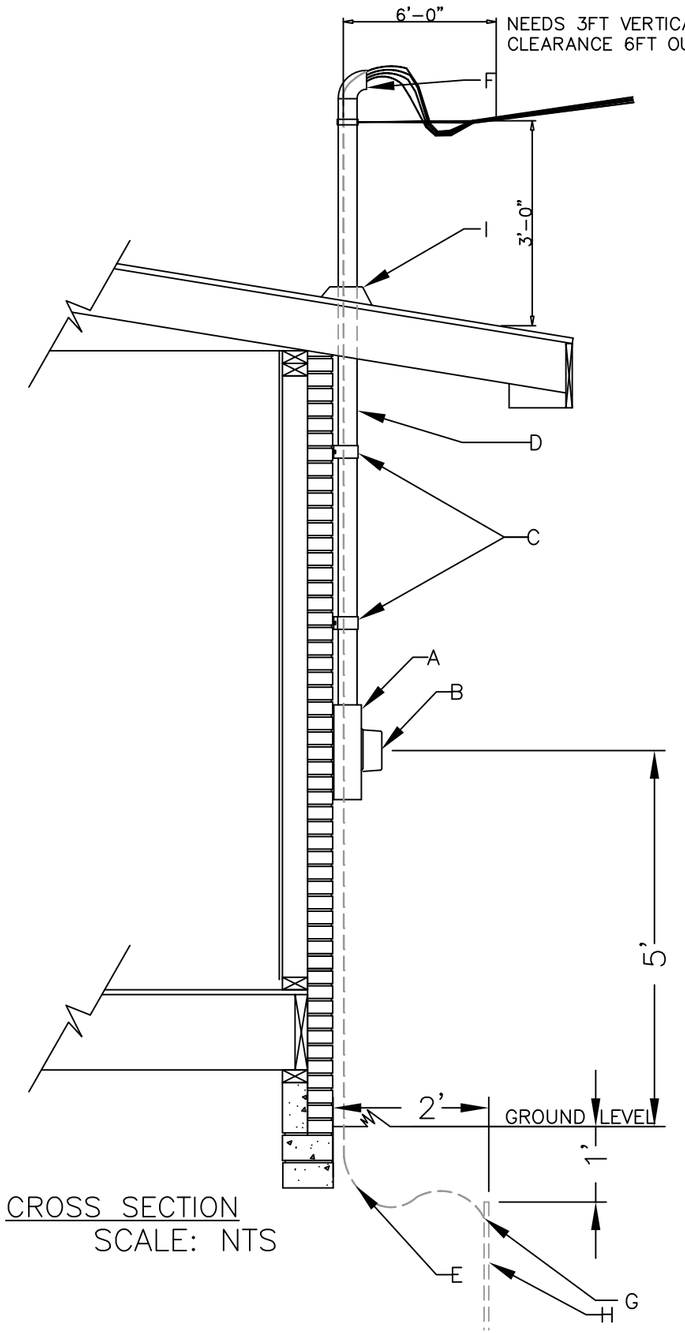

CROSS SECTION
SCALE: NTS

SEE ALL NOTES BEFORE CONSTRUCTION

NOTE :

1. Ground shall be fastended to the wall, below meter, and through mast above.

2. Some local codes may require outside disconnects and/or inspection before power is connected to meter base.

**5. METER BASE MUST BE UL APPROVED

3. 18" Leades on wire at the weather head.
(2 hot wires, 1 neutral wire 1 ground wire)

4. Customer shall wire brush all conductors, apply a non–grit type inhibitor, and terminate per manufacturer's specifications.

	ITEM #		METER BASE DETAIL
**	1	1	200 AMP METER BASE – UL APPROVED
	2	1	GROUND LUG
	3	1	NEUTRAL LUG
	4	2	PLASTIC BUSHING
	5	1	2" HUB
	6		2" RIGID CONDUIT – OR EQUIVALENT
	7		#4 BARE COOPER WIRE
	8		METER OUT LINE (FOR REFERENCE)
	9		4/0 TYP. WIRE SIZE
	10		ENTRANCE CABLE SIZE IS DETERMINED BY SIZE OF SERVICE SEE COUNTY CODES / REQUIREMENTS BEFORE INSTALLING TO BE INSTALLED BY CUSTOMER.

	ITEM	#	CROSS SECTION MATERIAL
**	A	1	200 AMP METER BASE – UL APPROVED
	B	1	200 AMP METER (SUPPLIED BY DPI)
	C	2	2 HOLE PIPE STRAPS
	D		2" RIGID CONDUIT SCH 40 NEMA TC–2
	E		#4 BARE COPPER GROUND
	F	1	2" GALV. STEEL WEATHER HEAD
	G	2	GROUND ROD CLAMP
	H	2	8' GROUND ROD – SPACED MINIMUM 6' APART
	I		ROOF FLASHING

JOB NAME 200 AMP UNDERGROUND METER BASE

CUSTOMER ANY EXISTING OR APPLYING DPI MEMBER


DATE AUGUST 4, 2026 SHEET 1 OF 1

1400 S. Davis RD.
LaGRANGE, GEORGIA
30241- 6112


PHONE #
706-845-2000
1-800-845-8362

DIVERSE POWER

TYPICAL ONLY

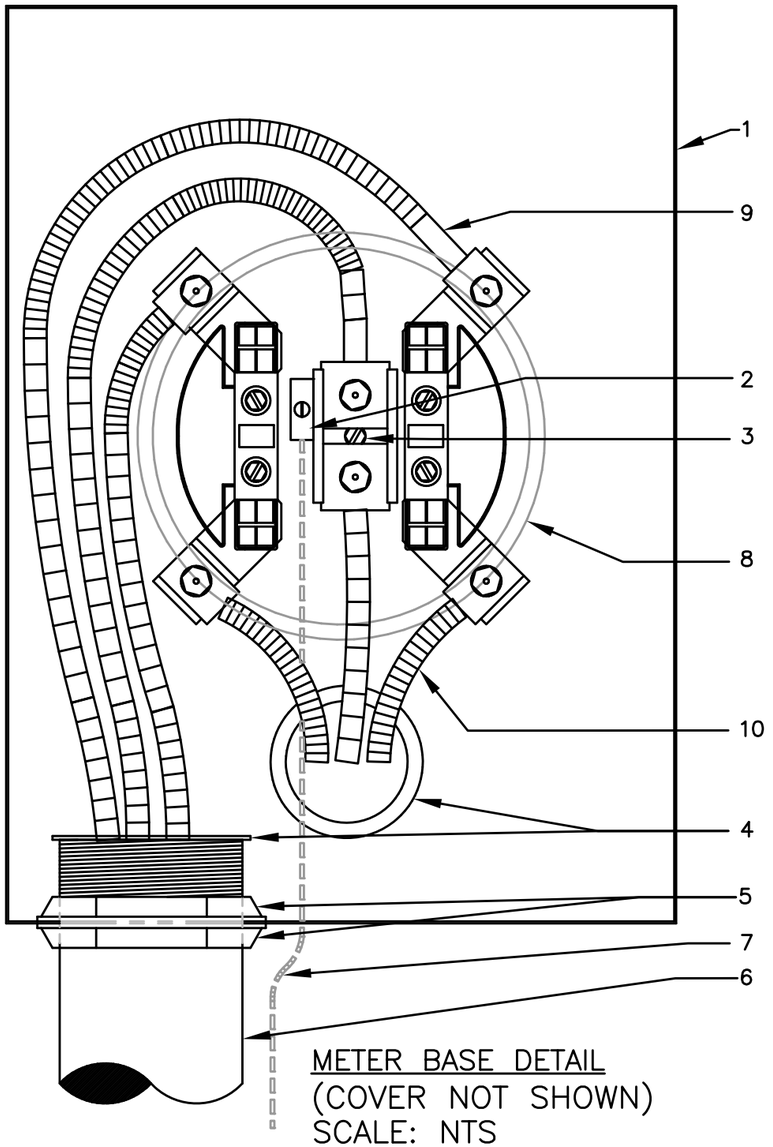

METER BASE DETAIL
(COVER NOT SHOWN)
SCALE: NTS

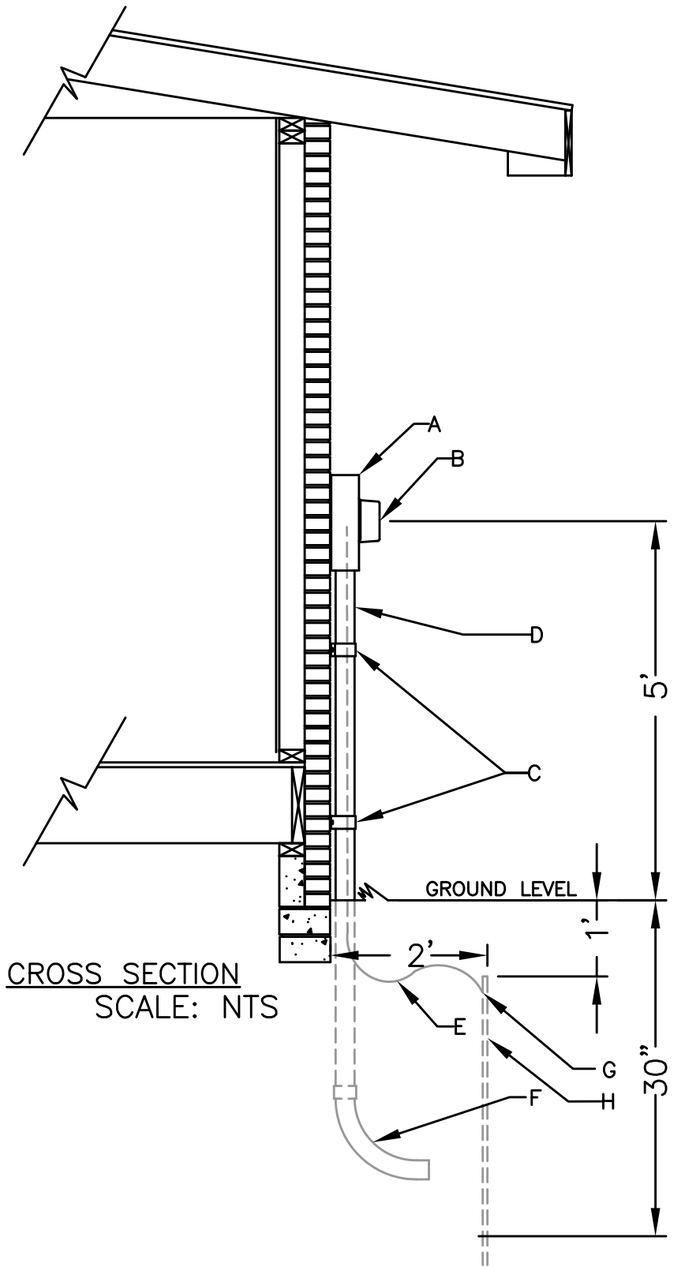

CROSS SECTION
SCALE: NTS

SEE ALL NOTES BEFORE CONSTRUCTION

NOTE :

1. A single 10' piece of conduit may be used only by making a 45° bend at ground level.

2. Some local codes may require outside disconnects and/or inspection before power is connected.

**5. METER BASE MUST BE UL APPROVED

3. Meter base must be mounted to specs.

4. Customer shall wire brush all conductors, apply a non-grit type inhibitor, and terminate per manufacturer's specifications.

	ITEM #		METER BASE DETAIL
**	1	1	200 AMP METER BASE – UL APPROVED
	2	1	GROUND LUG
	3	1	NEUTRAL LUG
	4	2	PLASTIC BUSHING
	5	2	CONDUIT LOCK NUTS
	6		2 1/2" PVC SCH 40
	7		#4 BARE COOPER WIRE
	8		METER OUT LINE (FOR REFERENCE)
	9		4/0 TYP. AL. WIRE SIZE
	10		ENTRANCE CABLE SIZE IS DETERMINED BY SIZE OF SERVICE SEE COUNTY CODES / REQUIREMENTS BEFORE INSTALLING INSTALLED BY CUSTOMER.

	ITEM	#	CROSS SECTION MATERIAL
**	A	1	200 AMP METER BASE – UL APPROVED
	B	1	200 AMP METER (SUPPLIED BY DPI)
	C	2	2 1/2" HOLE PIPE STRAPS
	D		2 1/2" PVC CONDUIT SCH 40
	E		#4 BARE COPPER GROUND
	F	1	2 1/2" 90° LONG SWEEPING ELBOW
	G	2	GROUND ROD CLAMP
	H	2	8' GROUND ROD – SPACED MINIMUM 6' APART

JOB NAME 320 AMP OVERHEAD METERBASE

CUSTOMER ANY EXISTING OR APPLYING DPI MEMBER


DATE AUGUST 4, 2026 SHEET 1 OF 1

1400 S. Davis RD.
LaGRANGE, GEORGIA
30241– 6112


PHONE #
706–845–2000
1–800–845–8362

DIVERSE POWER

TYPICAL ONLY

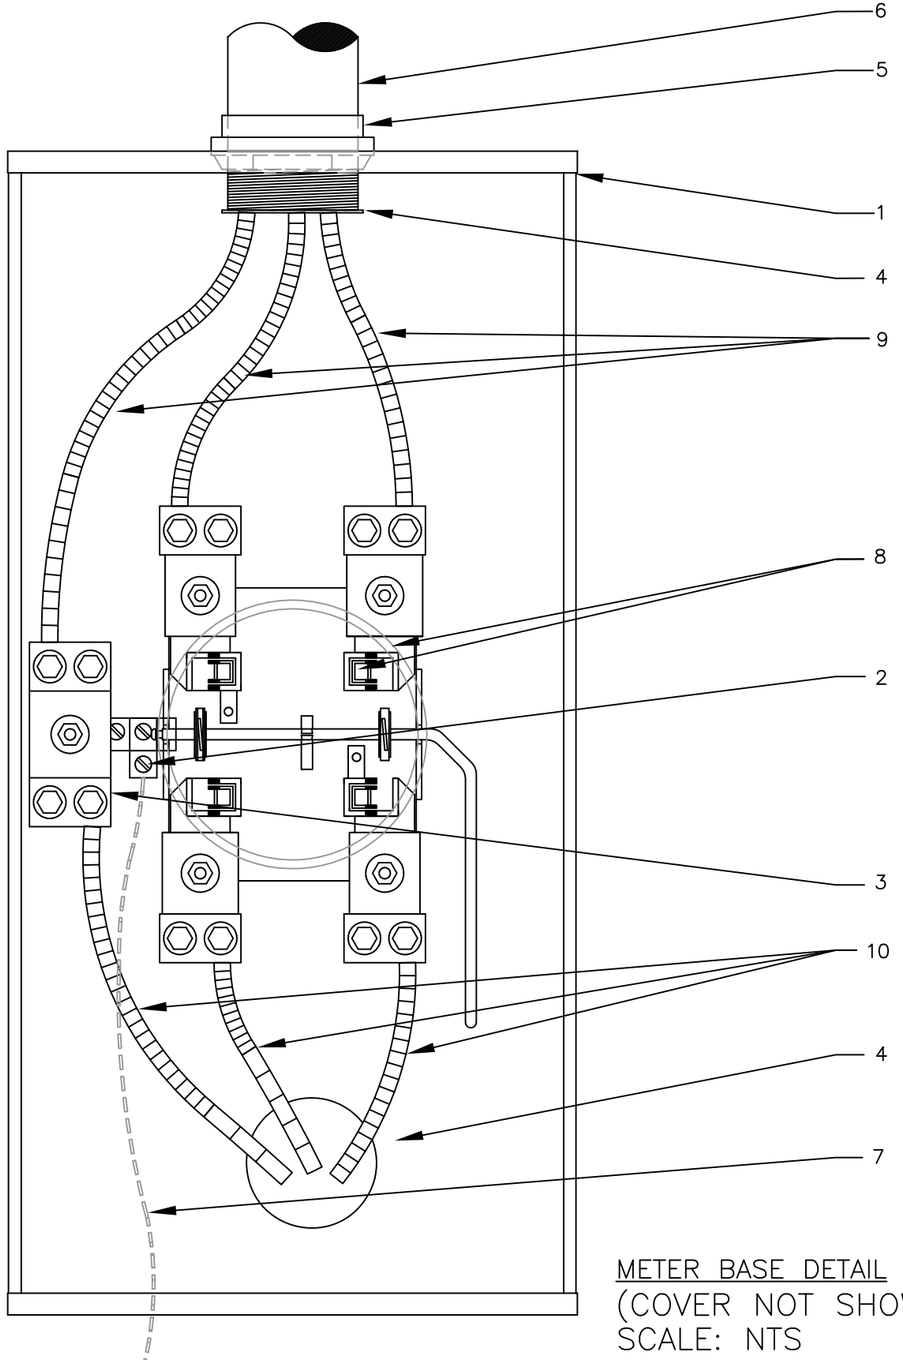

METER BASE DETAIL
(COVER NOT SHOWN)
SCALE: NTS

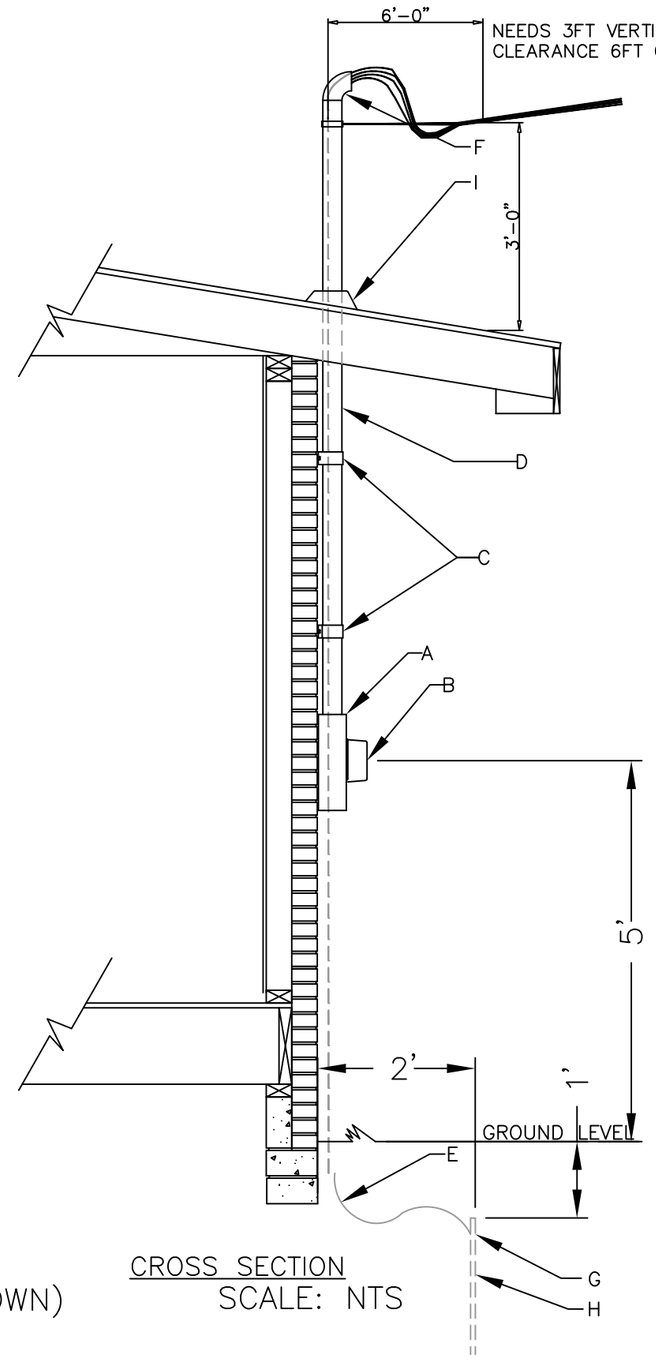

CROSS SECTION
SCALE: NTS

SEE ALL NOTES BEFORE CONSTRUCTION

NOTE :

1. Ground should be fastended to the wall, below meter, and thru mast above.

2. Some local codes may require outside disconnects and/or inspection before power is connected.

3. 18" Leades on wire at the weather head.
(2 hot wires, 1 neutral wire
1 ground wire)

4. Customer shall wire brush all conductors, apply a non–grit type inhibitor, and terminate per manufacturer's specifications.

**5. METER BASE MUST BE UL APPROVED

	ITEM #		METER BASE DETAIL
**	1	1	320 AMP METER BASE – UL APPROVED
	2	1	GROUND LUG
	3	1	NEUTRAL LUG
	4	2	PLASTIC BUSHING
	5	1	3" HUB
	6		3" GAV. STEEL CONDUIT
	7		#4 BARE COOPER WIRE
	8		METER AND MOUNTING STUDS (FOR REFERENCE)
	9		WIRE SIZED TO PANEL(S)
	10		ENTRANCE CABLE SIZE IS DETERMINED BY SIZE OF SERVICE SEE COUNTY CODES / REQUIREMENTS BEFORE INSTALLING. INSTALLED BY CUSTOMER

	ITEM	#	CROSS SECTION MATERIAL
**	A	1	320 AMP METER BASE – UL APPROVED
	B	1	320 AMP METER (SUPPLIED BY DPI)
	C	2	2 HOLE PIPE STRAPS
	D		3" RIGID CONDUIT PIPE OR EQUIVALENT
	E		#4 BARE COPPER GROUND
	F	1	3" GALV. STEEL WEATHER HEAD
	G	2	GROUND ROD CLAMP
	H	2	8' GROUND ROD – SPACE MINIMUM 6' APART
	I		ROOF FLASHING

Job Name TYP. 320 AMP UNDERGROUND METER BASE DWG.

Customer ANY EXISTING OR APPLYING DPI MEMBER


Date AUGUST 4, 2026 Sheet 1 of 1

1400 S. Davis RD.
LaGRANGE, GEORGIA
30241- 6112


PHONE #
706-845-2000
1-800-845-8362

DIVERSE POWER

TYPICAL ONLY

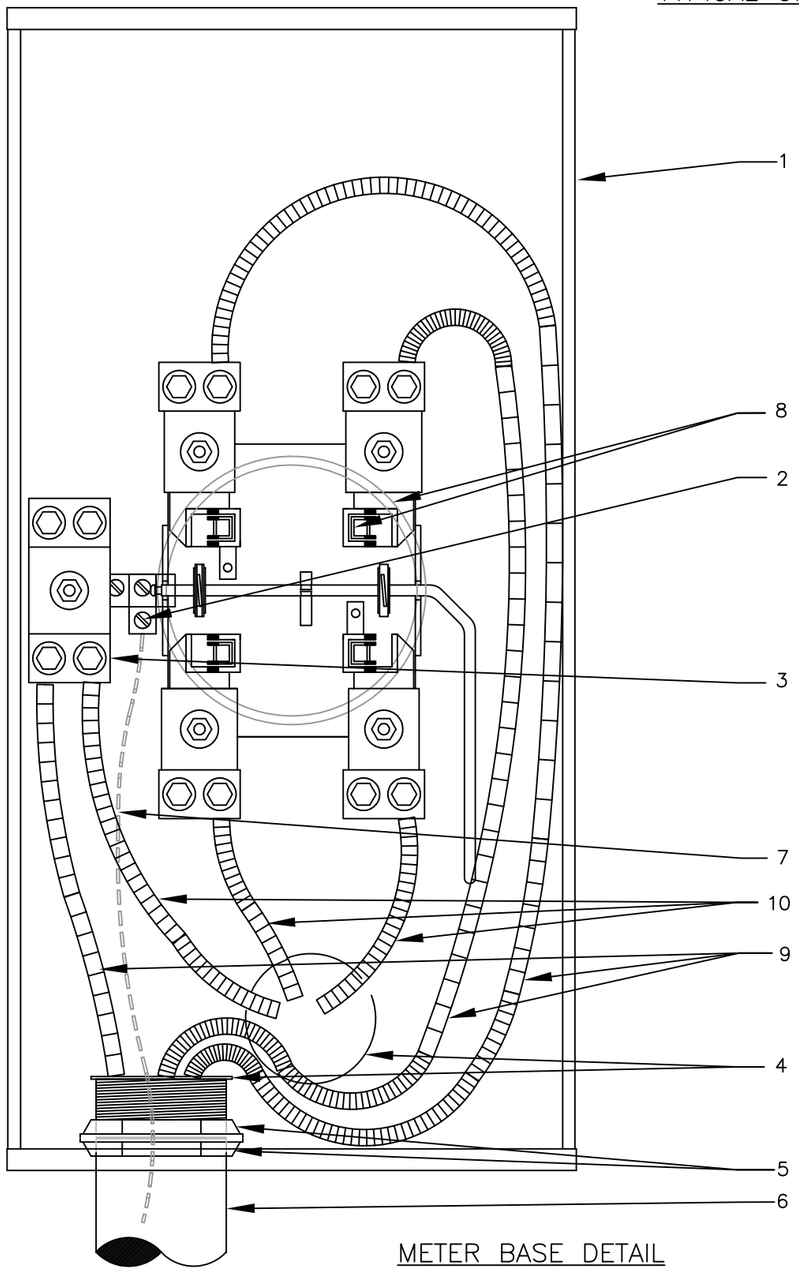

METER BASE DETAIL
(COVER NOT SHOWN)
SCALE: NTS

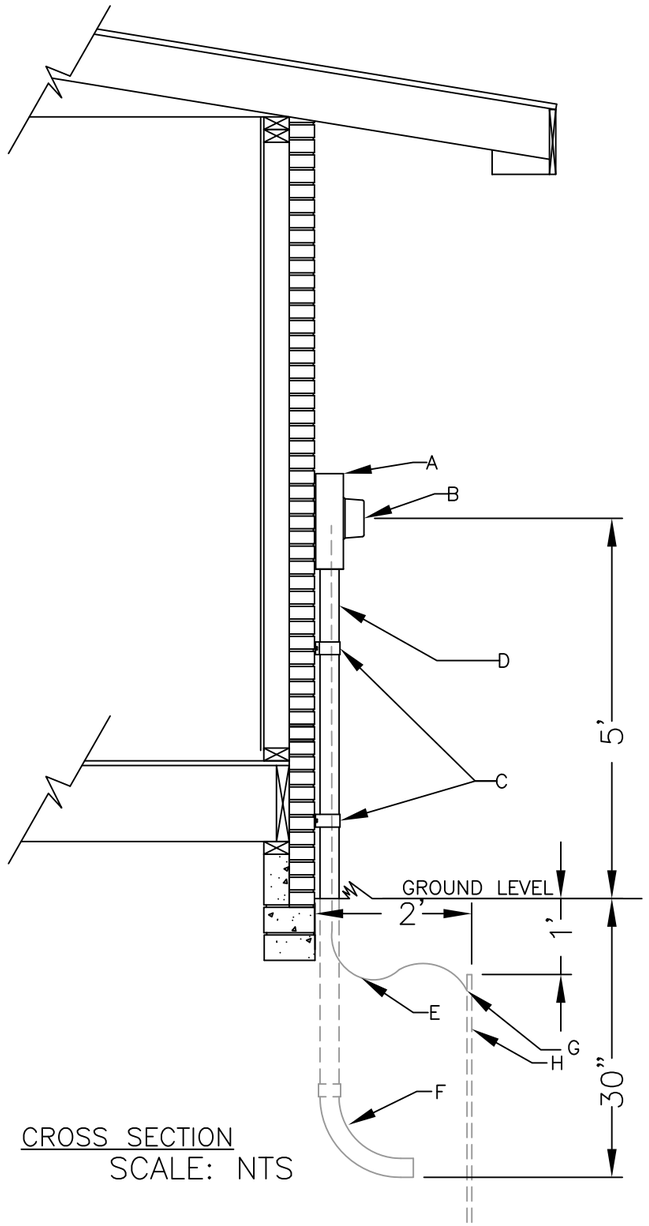

CROSS SECTION
SCALE: NTS

SEE ALL NOTES BEFORE CONSTRUCTION

NOTE :

1. A single 10' piece of RIDGE PVC sch 40 NEMA TC-2 conduit may be used by bending a 45° at ground level.

2. Some local codes may require outside disconnects and/or inspection before power is connected.

3. Meter base must be mounted to spec requirements.

4. Customer shall wire brush all conductors, apply a non-grit type inhibitor, and terminate per manufacturer's specifications.

**5. METER BASE MUST BE UL APPROVED

	ITEM #		METER BASE DETAIL
**	1	1	320 AMP METER BASE – UL APPROVED
	2	1	GROUND LUG
	3	1	NEUTRAL LUG
	4	2	PLASTIC BUSHING
	5	2	CONDUIT LOCK NUTS
	6		3" PVC CONDUIT
	7		#4 BARE COOPER WIRE
	8		METER AND MOUNTING STUDS
	9		WIRE SIZED TO PANEL(S)
	10		ENTRANCE CABLE SIZE IS DETERMINED BY SIZE OF SERVICE SEE COUNTY CODES / REQUIREMENTS BEFORE INSTALLING INSTALLED BY CUSTOMER.

	ITEM	#	CROSS SECTION MATERIAL
**	A	1	320 AMP METER BASE – UL APPROVED
	B	1	320 AMP METER (SUPPLIED BY DPI)
	C	2	3" 2 HOLE PIPE STRAPS
	D		2" RIGID PVC CONDUIT SCH 40 NEMA TC-2
	E		#4 BARE COPPER GROUND
	F	1	90° SWEEP
	G	2	GROUND ROD CLAMP
	H	2	8' GROUND ROD – SPACE MINIMUM 6' APART

JOB NAME 400 AMP OVERHEAD METERBASE

CUSTOMER ANY EXISTING OR APPLYING DPI MEMBER


DATE AUGUST 4, 2026

SHEET 1 OF 1


1400 S. Davis RD.
LaGRANGE, GEORGIA
30241– 6112

PHONE #
706–845–2000
1–800–845–8362

DIVERSE POWER

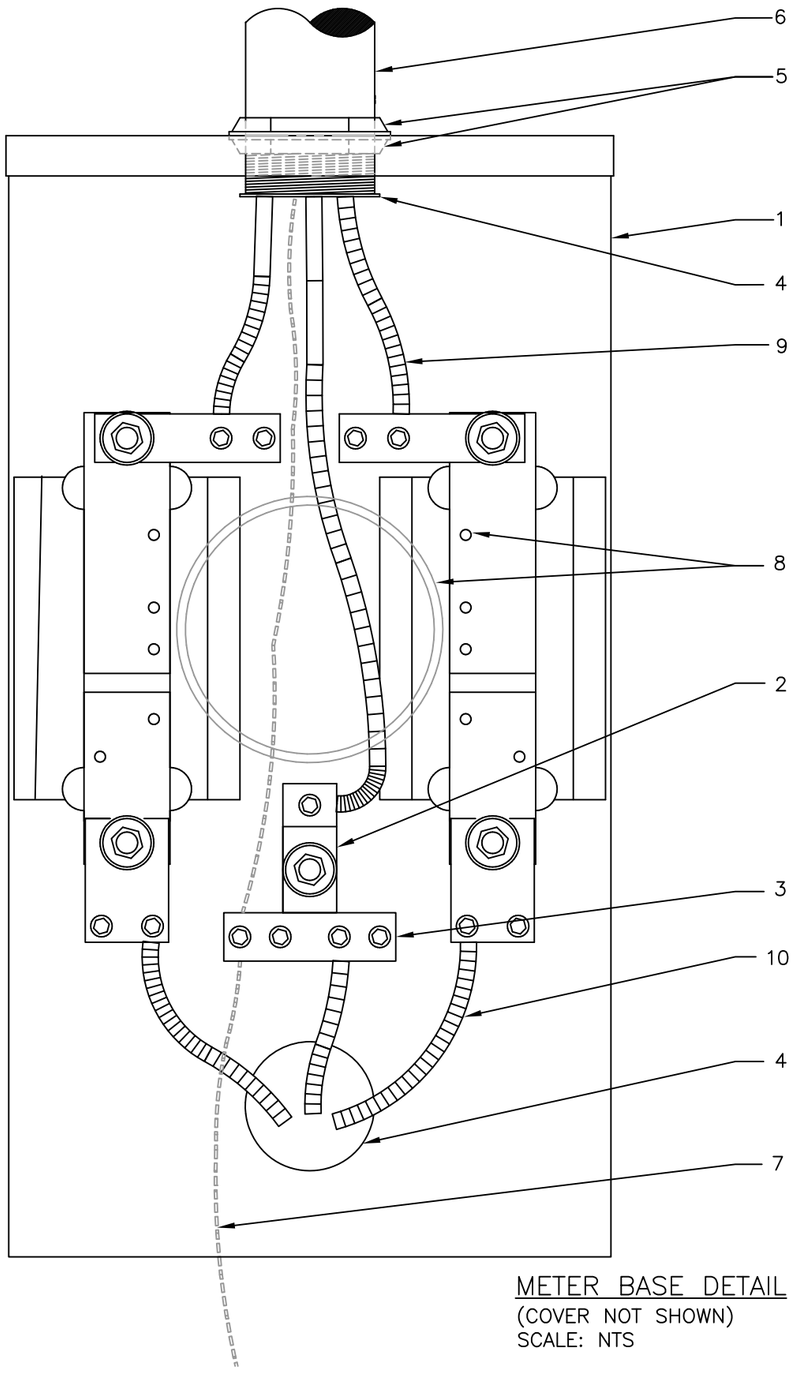

METER BASE DETAIL
(COVER NOT SHOWN)
SCALE: NTS

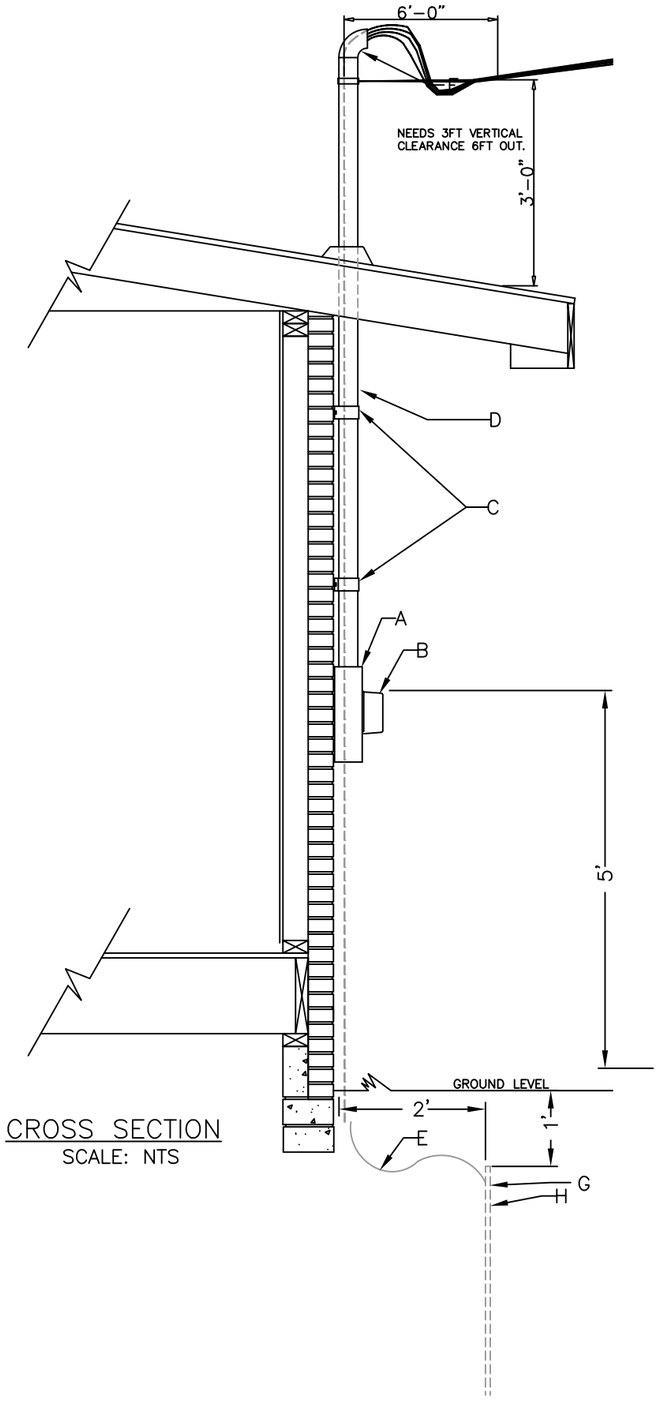

CROSS SECTION
SCALE: NTS

SEE ALL NOTES BEFORE CONSTRUCTION

NOTE :

1. Ground should be fastended to the wall, below meter, and thru mast above.

2. Some local codes may require outside disconnects and/or inspection before power is connected.

3. 18" Leades on wire at the weather head.
(2 hot wires, 1 neutral wire
1 ground wire)

4. All wires must be wire brushed prior to connection to meter base.

**5. METER BASE MUST BE UL APPROVED

	ITEM #		METER BASE DETAIL
**	1	1	400 AMP METER BASE – UL APPROVED
	2	1	GROUND LUG
	3	1	NEUTRAL LUG
	4	2	PLASTIC BUSHING
	5	2	CONDUIT LOCKNUTS
	6		3" GAV. STEEL CONDUIT
	7		#4 BARE COOPER WIRE
	8		METER AND MOUNTING STUDS (FOR REFERENCE)
	9		4/0 TYP. WIRE SIZE
	10		ENTRANCE CABLE SIZE IS DETERMINDED BY SIZE OF SERVICE SEE COUNTY CODES / REQUIRMENTS BEFORE INSTALLING INSTALLED BY CUSTOMER.

	ITEM	#	CROSS SECTION MATERIAL
**	A	1	400 AMP METER BASE – UL APPROVED
	B	1	400 AMP METER (SUPPLIED BY DPI)
	C	2	2 HOLE PIPE STRAPS
	D		3" GALV. STEEL PIPE
	E		#4 BARE COPPER GROUND
	F	1	3" GALV. STEEL WEATHER HEAD
	G	2	GROUND ROD CLAMP
	H	2	8' GROUND ROD – SPACED MINIMUM 6' APART

Job Name TYP. 400 AMP UNDERGROUND METER BASE DWG.


Customer ANY EXISTING OR APPLYING DPI MEMBER

Date AUGUST 4, 2026 Sheet 1 of 1


1400 S. Davis RD.
LaGRANGE, GEORGIA
30241- 6112

PHONE #
706-845-2000
1-800-845-8362

DIVERSE POWER

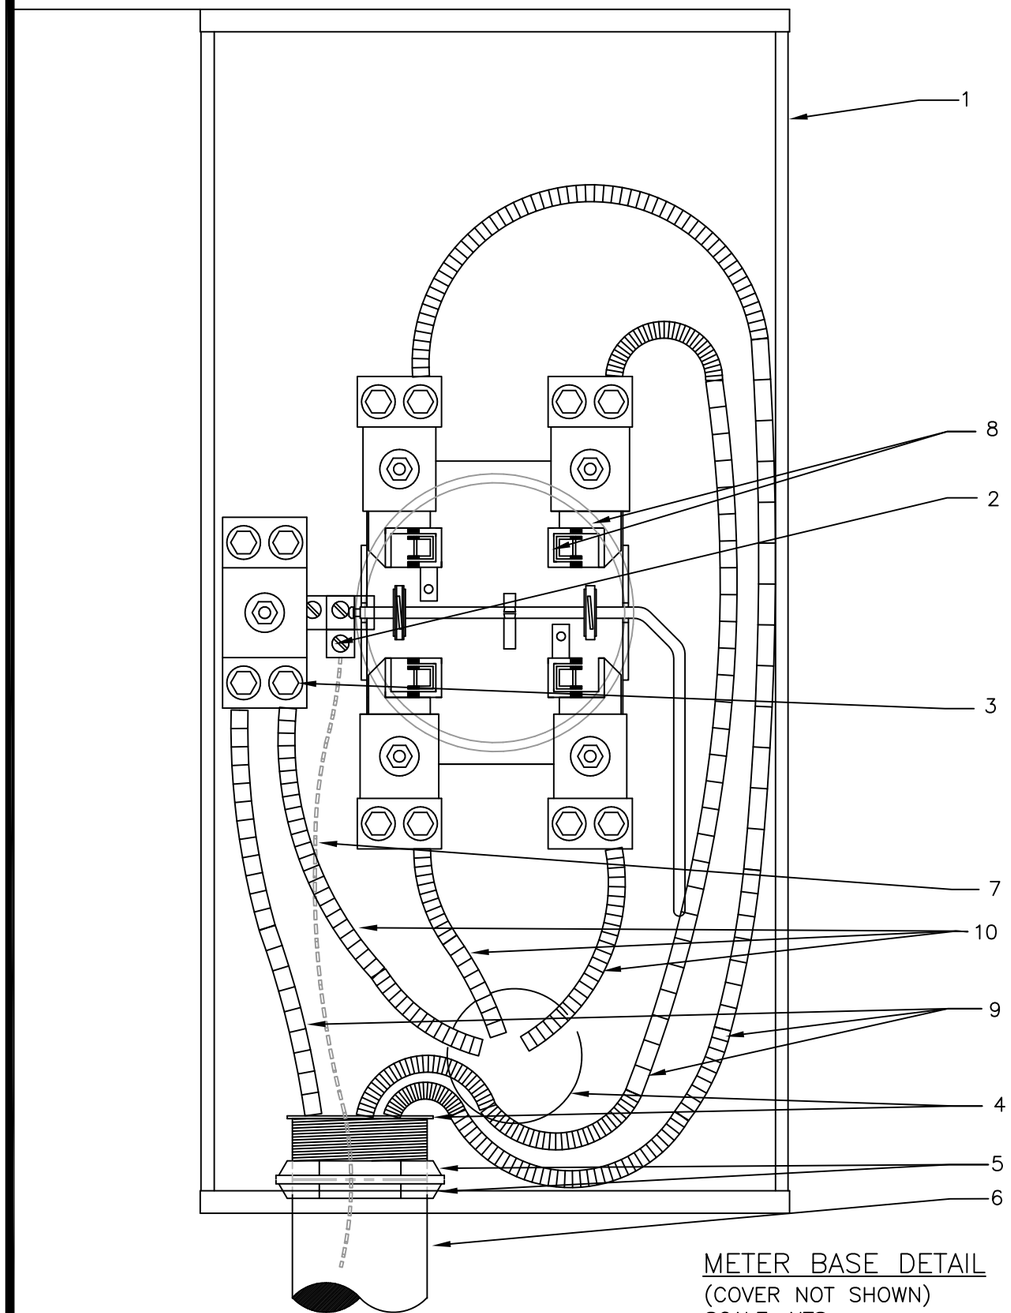

METER BASE DETAIL
(COVER NOT SHOWN)
SCALE: NTS

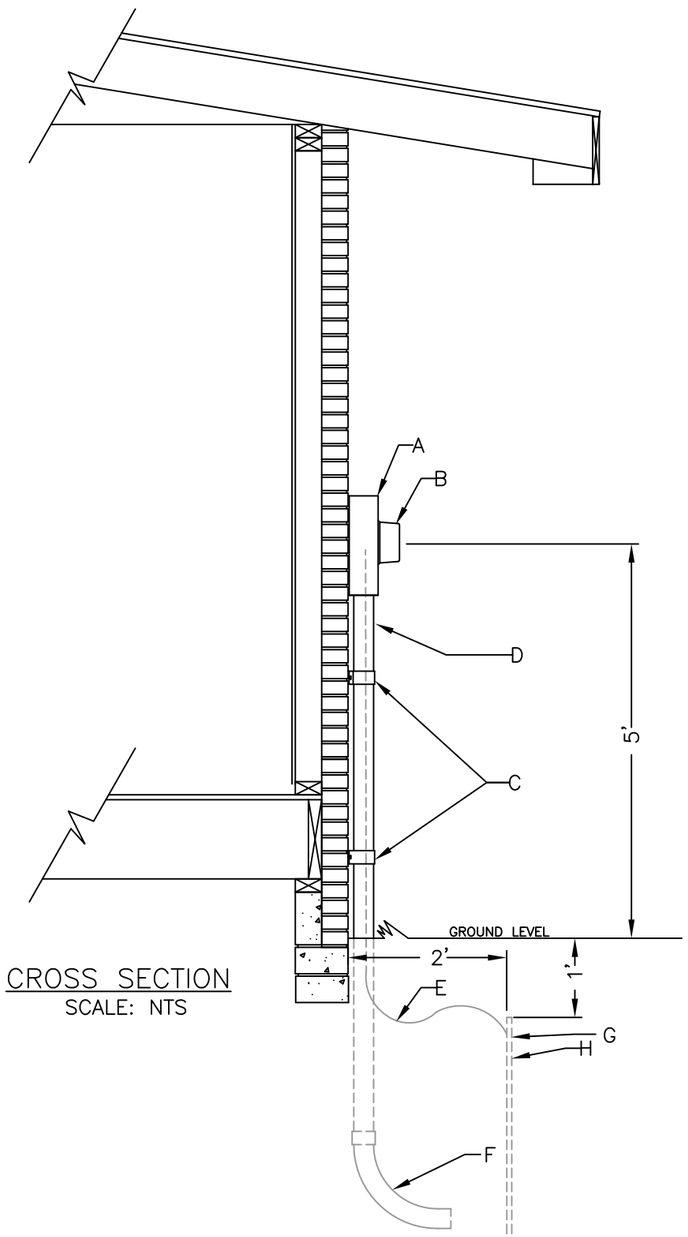

CROSS SECTION
SCALE: NTS

SEE ALL NOTES BEFORE CONSTRUCTION

NOTE :

1. A single 10' piece of RIDGE PVC sch 40 NEMA TC-2 conduit may be used by bending a 45° at ground level.

2. Some local codes may require outside disconnects and/or inspection before power is connected.

3. Meter base must be mounted to spec requirements.

4. All wires must be wire brushed prior to connection to meter base.

**5. METER BASE MUST BE UL APPROVED

	ITEM #		METER BASE DETAIL
**	1	1	400 AMP METER BASE – UL APPROVED
	2	1	GROUND LUG
	3	1	NEUTRAL LUG
	4	2	PLASTIC BUSHING
	5	2	CONDUIT LOCKNUTS
	6		3" PVC CONDUIT
	7		#4 BARE COOPER WIRE
	8		METER AND MOUNTING STUDS (FOR REFERENCE)
	9		WIRE SIZED TO PANEL(S)
	10		ENTRANCE CABLE SIZE IS DETERMINED BY SIZE OF SERVICE SEE COUNTY CODES / REQUIREMENTS BEFORE INSTALLING INSTALLED BY CUSTOMER.

	ITEM	#	CROSS SECTION MATERIAL
**	A	1	400 AMP METER BASE – UL APPROVED
	B	1	400 AMP METER (SUPPLIED BY DPI)
	C	2	3" 2 HOLE PIPE STRAPS
	D		2" RIDGE PVC CONDUIT SCH 40 NEMA TC-2
	E		#4 BARE COPPER GROUND
	F	1	90° SWEEP
	G	2	GROUND ROD CLAMP
	H	2	8' GROUND ROD – SPACED MINIMUM 6' APART